


Hopkins Parking Ramp - Consumption Report

10/3/2012

Monthly Year Over Year
Electric

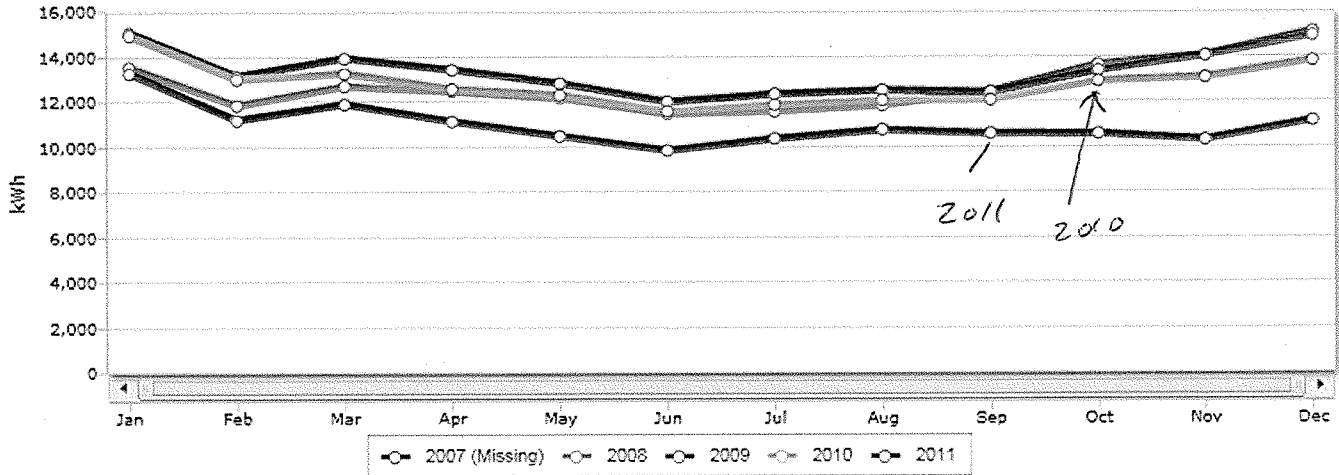

Year	Days	SF	Total kWh	Target kWh	Change from Target kWh	% Change	Total Energy Cost \$	Average Cost Rate \$ /kWh
2007	0	123,371	3,591	-	-	-	\$244.83	\$0.07
2008	366	123,371	152,912	-	-	-	\$11,155.36	\$0.07
2009	365	123,371	160,073	-	-	-	\$11,706.38	\$0.07
2010	365	123,371	153,542	-	-	-	\$11,373.27	\$0.07
2011	365	123,371	131,683	-	-	-	\$10,893.07	\$0.08

*New lighting control installed 12/1
Nov 2010,*


NO GAS in Building

Hopkins City Hall/ Police Station - Consumption Report

10/3/2012

Monthly Year Over Year

Natural Gas

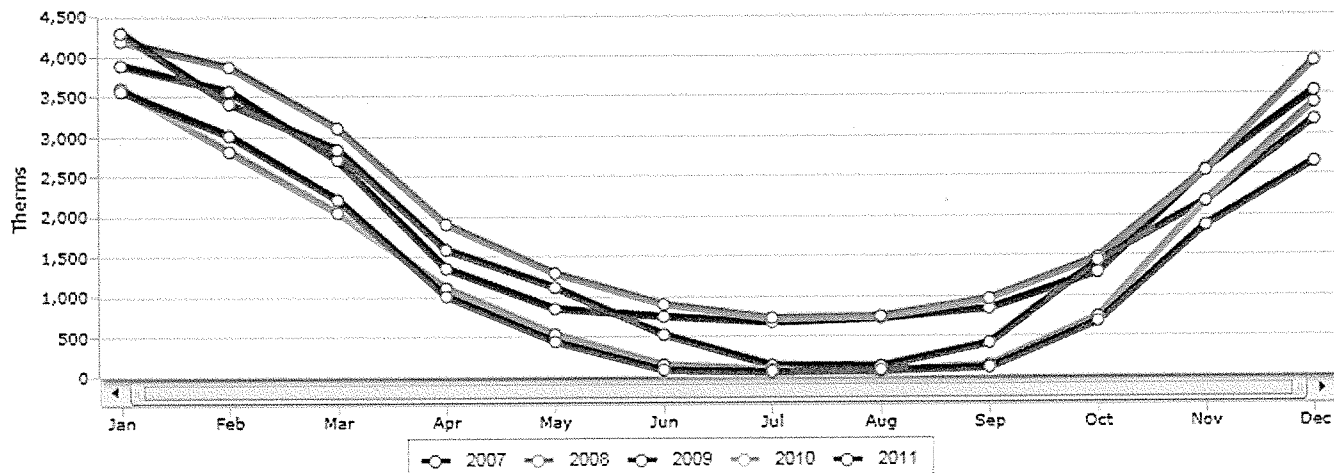


Year	Days	SF	Total Therms	Target Therms	Change from Target Therms	% Change	Total Energy Cost \$	Average Cost Rate \$ /Therm
2007	365	38,200	22,769	-	-	-	\$25,280.90	\$1.11
2008	366	38,200	25,654	-	-	-	\$28,659.62	\$1.12
2009	365	38,200	21,253	-	-	-	\$18,128.87	\$0.85
2010	365	38,200	16,839	-	-	-	\$14,388.69	\$0.85
2011	365	38,200	15,798	-	-	-	\$12,487.01	\$0.79

New Boilers installed 2010 mid year

Hopkins City Hall/ Police Station - Consumption Report

10/3/2012

Monthly Year Over Year
Electric

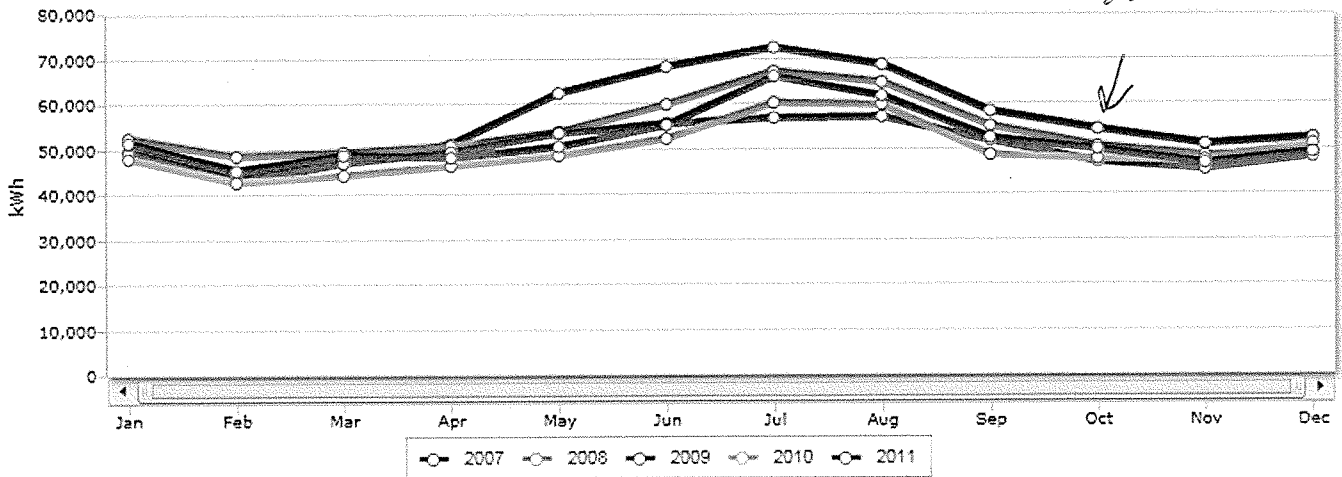

Year	Days	SF	Total kWh	Target kWh	Change from Target kWh	% Change	Total Energy Cost \$	Average Cost Rate \$ /kWh
2007	365	38,200	681,440	-	-	-	\$50,433.37	\$0.07
2008	366	38,200	650,902	-	-	-	\$49,681.40	\$0.08
2009	365	38,200	605,350	-	-	-	\$47,488.21	\$0.08
2010	365	38,200	598,174	-	-	-	\$48,622.03	\$0.08
2011	365	38,200	626,926	-	-	-	\$53,011.02	\$0.08

*New AC units installed in
2007*